

## Translation

In any case, the german original shall prevail.



BG ETEM, Prüfstelle Elektrotechnik, Gustav-Heinemann-Ufer 130,  
50968 Köln

UFE GmbH  
Joachim-Jungius-Str. 9  
18059 Rostock

Your ref.:  
Your correspondence da-  
Our ref. UB.010.17/ 11-4735-3029  
(please state): PI/AI  
Contact name: Wolfgang Pohl  
Fax: +49 221 3778-6322  
Date: 13.02.2012

## Test Certificate 11039

**Product:** Automatic switching device (ENS)  
**Type:** ENS 31  
**Intended use:** Automatic switching device, inaccessible to the distribution system operator, serving as a safety interface between a distributed generation system and the low-voltage grid. Equivalent substitute for a switching device with isolating function accessible at all times to the distribution system operator.

### Testing performed in accordance with:


DIN V VDE V 0126-1-1: "Automatic disconnection device between a  
2006-02 generator and the public low-voltage grid"

The safety concept of the product satisfies the technical safety requirements in force at the time of issue of the present certificate for the normal use indicated.

Differing from Sec. 4.3 of the test specifications, the upper frequency monitoring switch-off point may be established according to FNN „Technical note - Basic conditions for interim regulation of frequency-dependent active power control of PV systems in low voltage networks (March 2011)“.

The validity of the certificate of compliance shall cease no later than:

**31 December 2014**

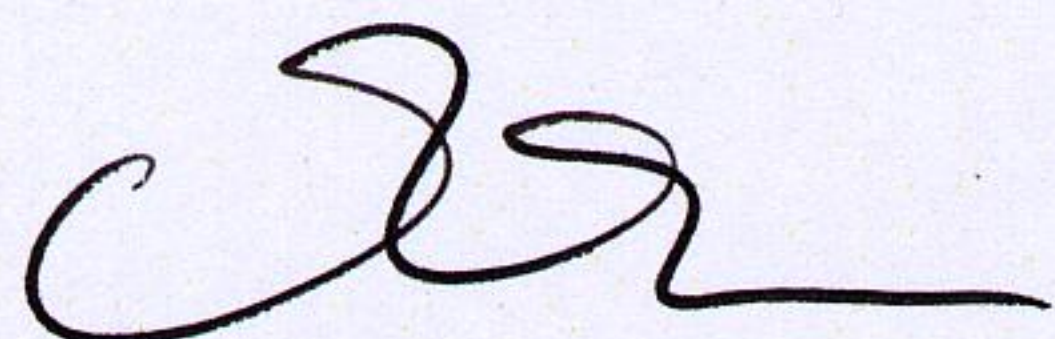

Martin Mehlem  
Head of the test body Electrical Engineering